


Körnungslinie

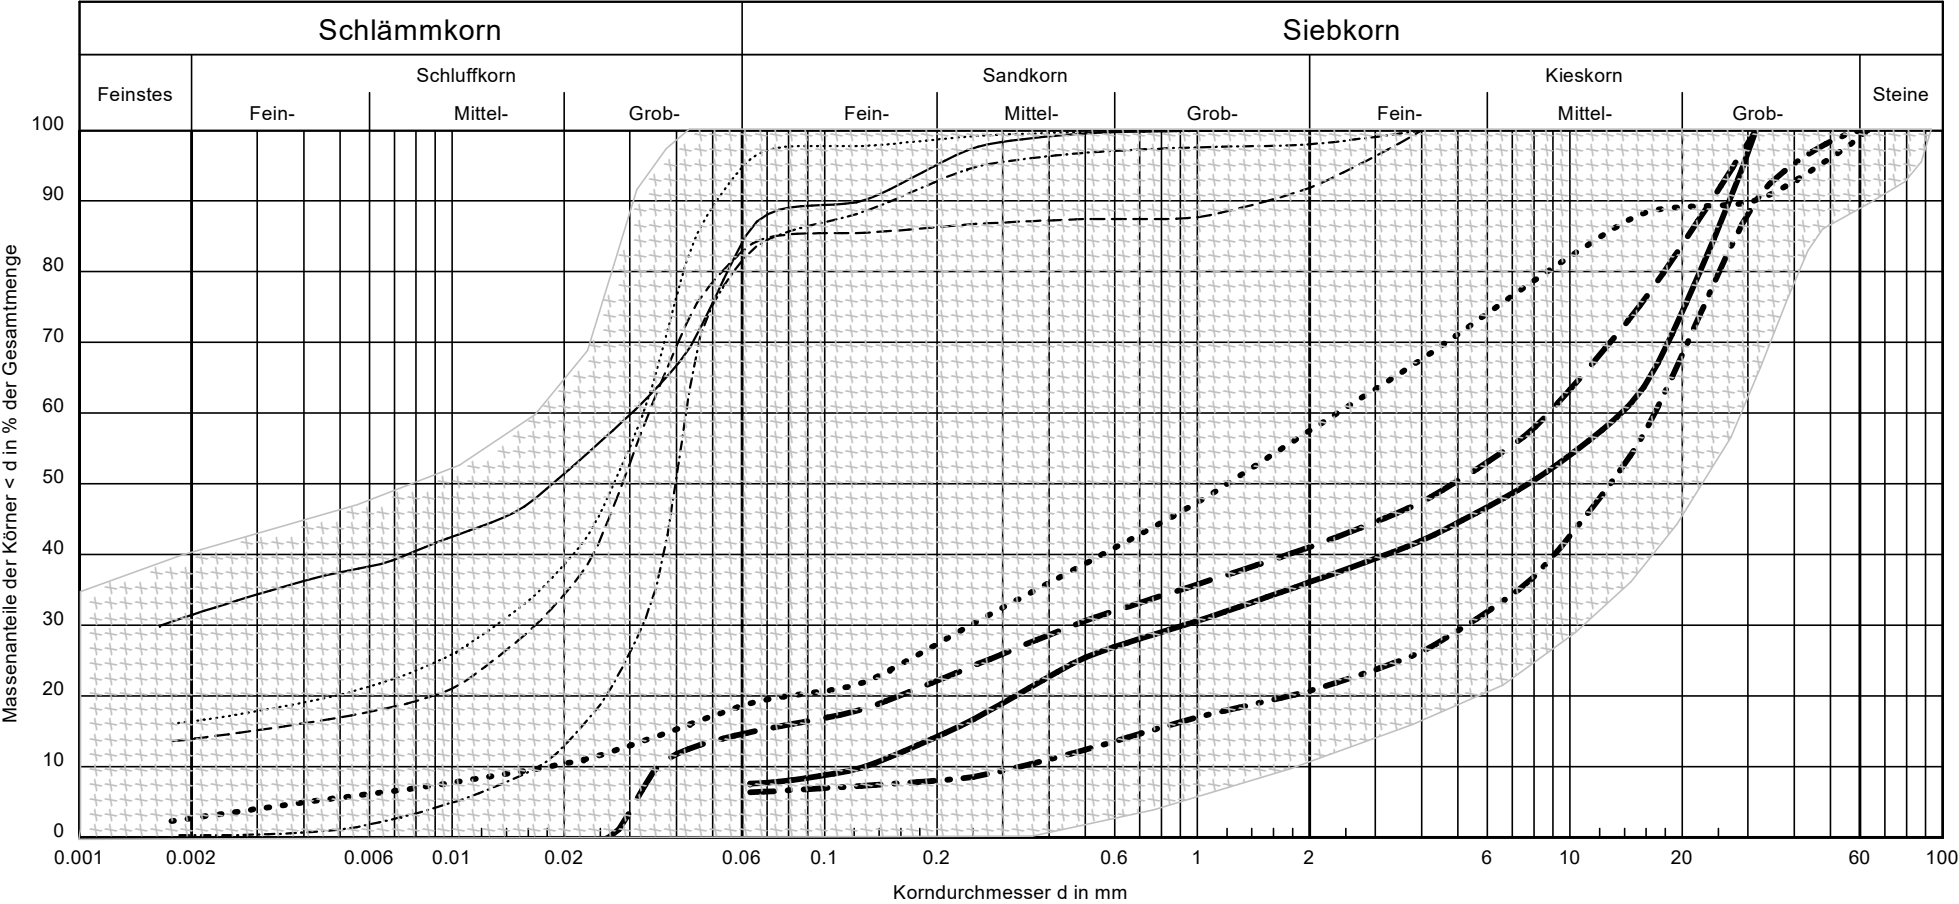


|                     |                 |                    |               |                |                 |                          |             |                   |
|---------------------|-----------------|--------------------|---------------|----------------|-----------------|--------------------------|-------------|-------------------|
| Labor-Nr.           | 7420            | 7421               | 7422          | 7423           | 7424            | 7425                     | 7426        | 7427              |
| Entnahmestelle      | RKS 5           | RKS 1              | RKS 7         | RKS 12         | RKS 11          | RKS 9                    | RKS 1       | RKS 3             |
| Entnahmetiefe ( m ) | 0,0 - 0,5       | 0,0 - 0,6          | 1,2 - 2,4     | 0,6 - 1,2      | 1,4 - 2,2       | 0,8 - 2,0                | 0,6 - 0,8   | 0,7 - 1,7         |
| Bodenart            | A (G, u', s), k | A (G, u', s, ö, k) | A (G, u', s') | A (G, u, s), k | A (U, t, s'), k | A? (U, t', s', g', o), k | A (U, s, ö) | A? (U, t, s', o') |
| Wassergehalt ( % )  | 9,3             | 9,4                | 3,6           | 9,4            | 18,6            | 21,5                     | 30,7        | 25,5              |
| Signatur            | —————           | -----              | -. - . - .    | .....          | —————           | -----                    | -----       | .....             |

GRUNDBAUINSTITUT BIEDEBACH  
Hellerstraße 21  
44229 Dortmund  
www.gbdo.de

Bearb. - Nr.: 3165  
Anlage - Nr.: 1/5.1

Körnungslinie

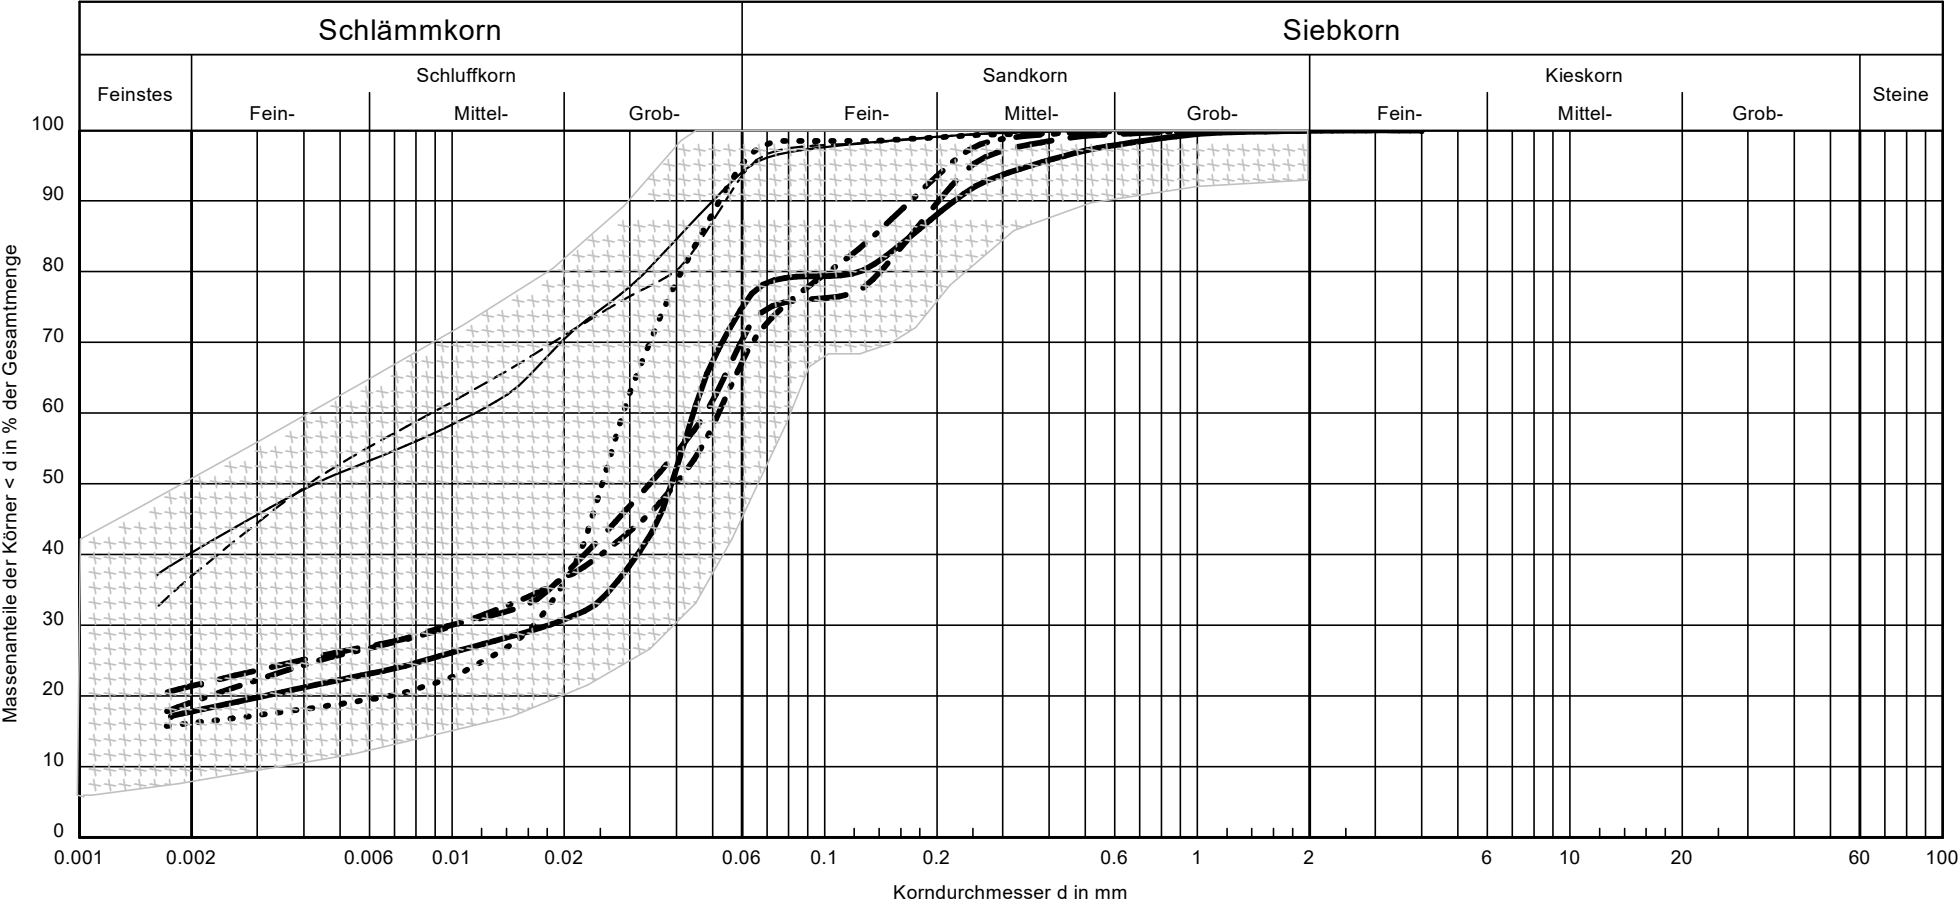

|                     |           |           |             |           |                        |                        |
|---------------------|-----------|-----------|-------------|-----------|------------------------|------------------------|
| Labor-Nr.           | 7428      | 7429      | 7430        | 7431      | 7432                   | 7433                   |
| Entnahmestelle      | RKS 5     | RKS 9     | RKS 1       | RKS 8     | RKS 11                 | RKS 2                  |
| Entnahmetiefe ( m ) | 1,7 - 2,4 | 2,0 - 3,2 | 0,8 - 2,0   | 0,6 - 2,2 | 2,2 - 3,2              | 2,0 - 3,1              |
| Bodenart            | U, t, s   | U, t, s   | U, t, s̄, k | U, t      | Mst, v? (U, t̄, s'), k | Mst, v? (U, t̄, s'), k |
| Wassergehalt ( % )  | 23,6      | 25,3      | 19,0        | 18,5      | 22,7                   | 12,8                   |
| Signatur            | —————     | — — — —   | - . - . - . | .....     | —————                  | -----                  |

GRUNDBAUINSTITUT BIEDEBACH  
Hellerstraße 21  
44229 Dortmund  
www.gbdo.de

Bearb. - Nr.: 3165  
Anlage - Nr.: 1/5.2